
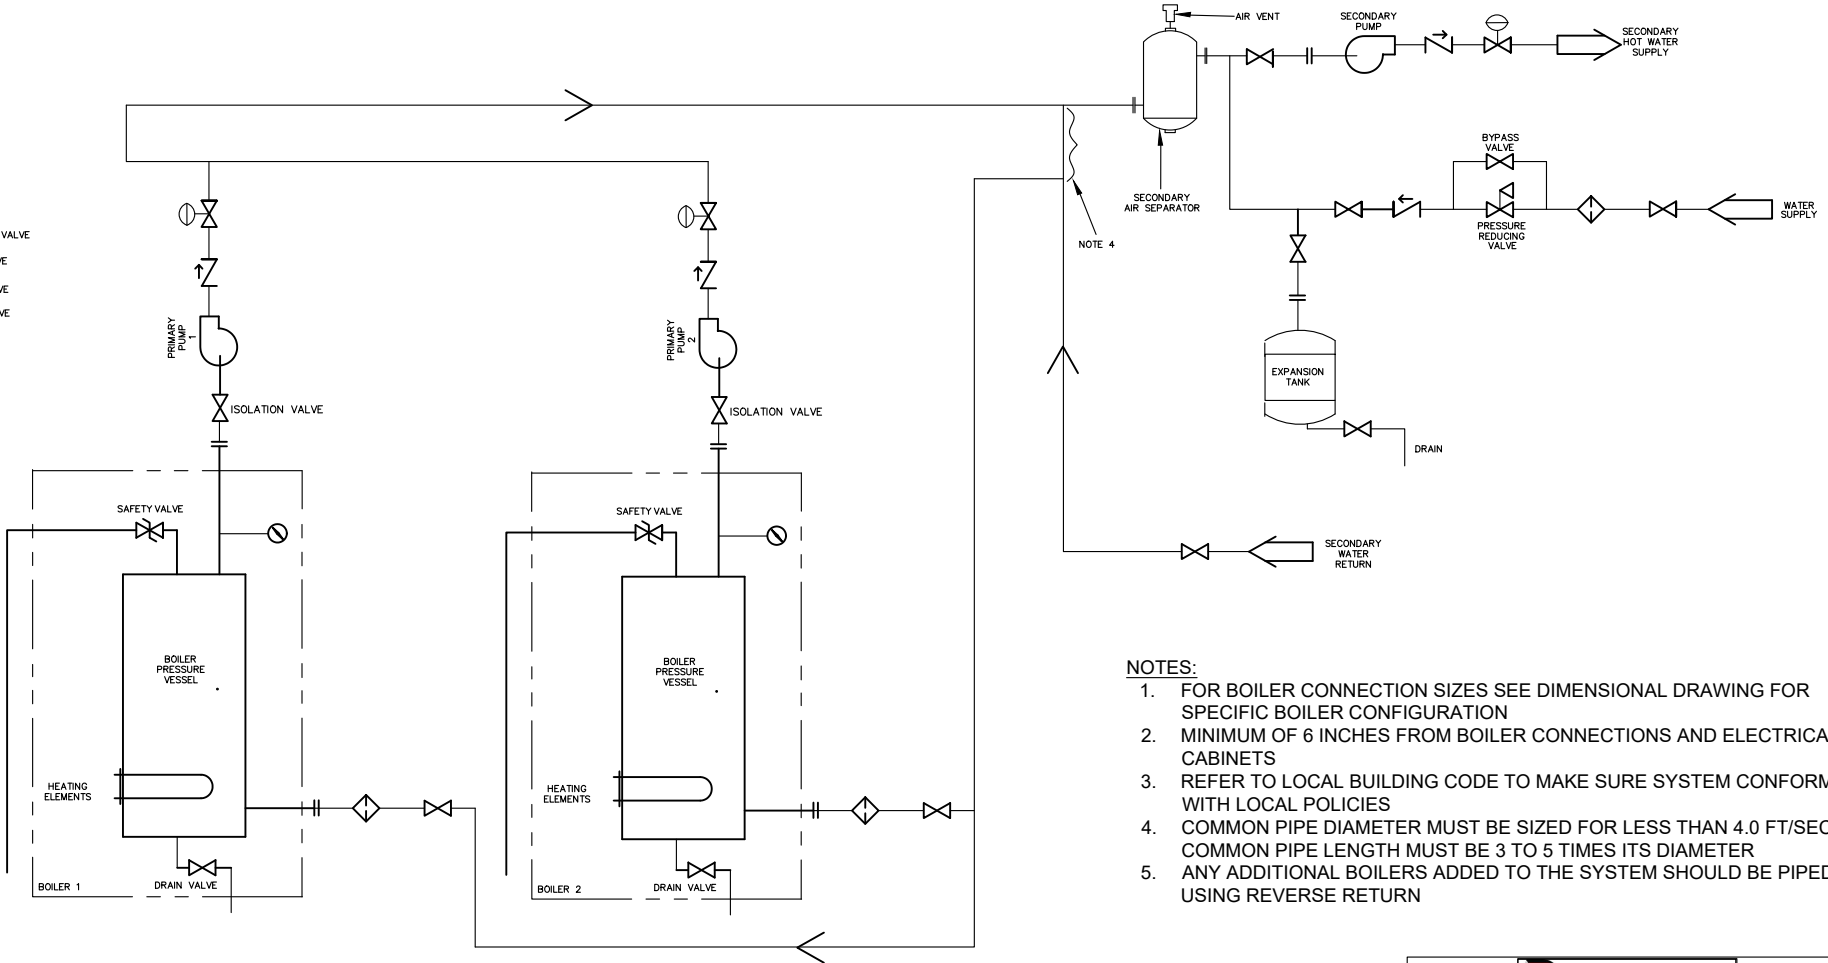


4

3

2

1



- NOTES:**
1. FOR BOILER CONNECTION SIZES SEE DIMENSIONAL DRAWING FOR SPECIFIC BOILER CONFIGURATION
 2. MINIMUM OF 6 INCHES FROM BOILER CONNECTIONS AND ELECTRICAL CABINETS
 3. REFER TO LOCAL BUILDING CODE TO MAKE SURE SYSTEM CONFORMS WITH LOCAL POLICIES
 4. COMMON PIPE DIAMETER MUST BE SIZED FOR LESS THAN 4.0 FT/SEC; COMMON PIPE LENGTH MUST BE 3 TO 5 TIMES ITS DIAMETER
 5. ANY ADDITIONAL BOILERS ADDED TO THE SYSTEM SHOULD BE PIPED USING REVERSE RETURN



439 MAIN RD. TOWACO NJ 07082
 PHONE: (800) 221-1522 FAX: (718) 386-7809

TITLE
**P&ID - EW HOT WATER BOILER
 PRIMARY-SECONDARY MULTIPLE UNIT**

A/2		PRINT REVIEW	SC	5/17/24
REV	ECN	REVISION DESCRIPTION	NAME	DATE

NAME	DATE	DWG#	REV
SC	5/17/24	EW-PnID-PRISECMULTI	A/2
CHECKED BY		SHEET 1 OF 1	

4

3

2

1