
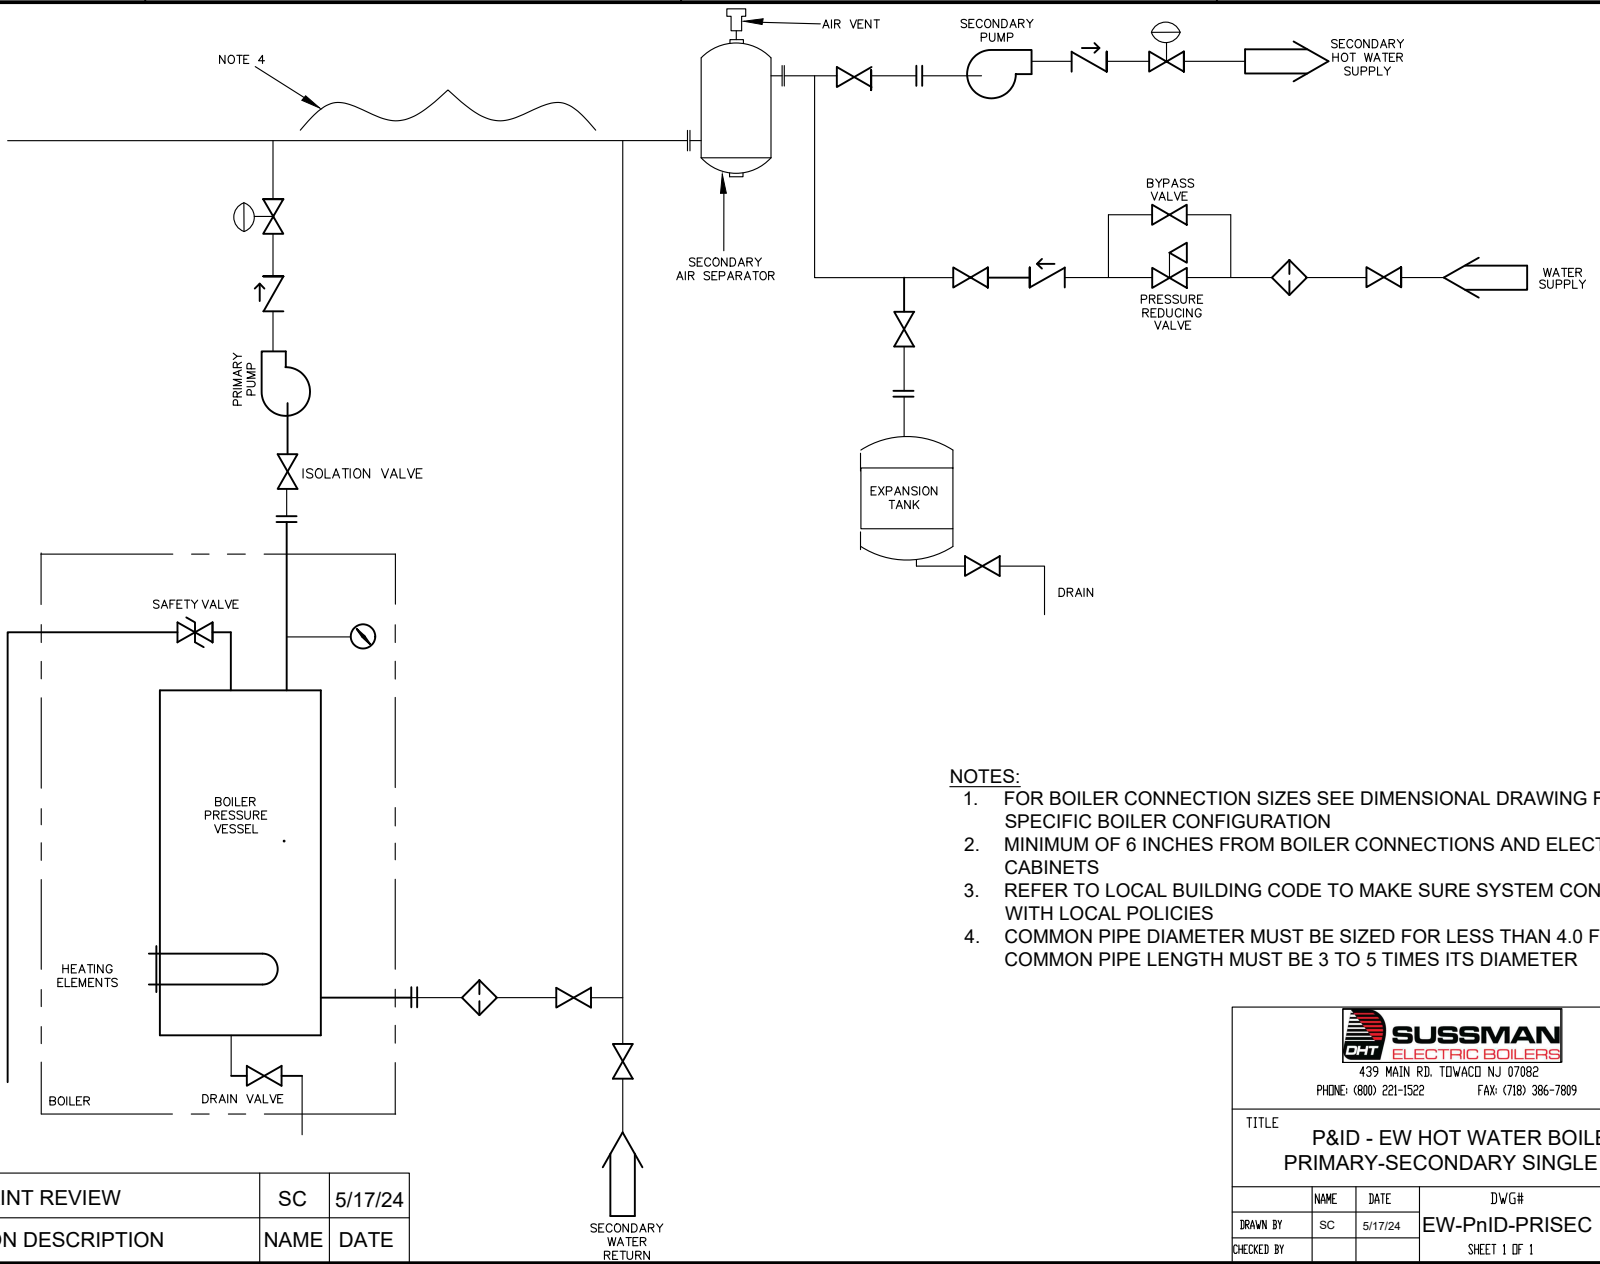


4

3

2

1

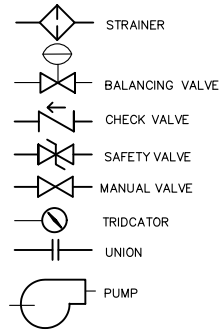

- NOTES:**
1. FOR BOILER CONNECTION SIZES SEE DIMENSIONAL DRAWING FOR SPECIFIC BOILER CONFIGURATION
 2. MINIMUM OF 6 INCHES FROM BOILER CONNECTIONS AND ELECTRICAL CABINETS
 3. REFER TO LOCAL BUILDING CODE TO MAKE SURE SYSTEM CONFORMS WITH LOCAL POLICIES
 4. COMMON PIPE DIAMETER MUST BE SIZED FOR LESS THAN 4.0 FT/SEC; COMMON PIPE LENGTH MUST BE 3 TO 5 TIMES ITS DIAMETER

A/1		PRINT REVIEW	SC	5/17/24
REV	ECN	REVISION DESCRIPTION	NAME	DATE

439 MAIN RD. TOWACO NJ 07082
 PHONE: (800) 221-1522 FAX: (718) 386-7809

TITLE				
P&ID - EW HOT WATER BOILER PRIMARY-SECONDARY SINGLE UNIT				
DRAWN BY	NAME	DATE	DWG#	REV
CHECKED BY	SC	5/17/24	EW-PnID-PRISEC	A/1
SHEET 1 OF 1				

4

3

2

1